




Systemtrennung  
zwingend erforderlich!  
(heat exchanger  
absolutely required!)

Gläsern gezeichnete Komponenten  
sind im Lieferumfang nicht enthalten!  
Glassy drawn components  
are not included in the delivery!

Ersatzteilliste (spare part list)

Pos.	Anz.	T.-Nr.	T.-Bez.
1	1	000 148	R7M_HLTS
2	1	000 146-R	R5MHLT-M-R
3	1	000 158-R	R8SHLTAR17RMHLTS-R
4	1	000 134	R4M_HLTS
5	1	000 664-R	R7MAR26RM_HLTS-R
6	1	000 693	R30S_HLTM
7	7	000 118	The 0-120°C Ø63 14,8x13,8
8	1	000 200 A	TMH Gehäuse A DN25 SYS Entladung L
9	1	000 622-L	KüEin TMH DN25 jet+sys-L
10	3	000 551	S M6x10 6KF
11	1	000 626-L	EMS 240 3P-L
12	1	000 035	Stellknopf S240
13	1	000 249	S M5x50 Zy-6K
14	1	000 250	SchU Ø5,3xØ10x1
15	1	000 251	SchF Ø5,3xØ10x0,6
16	7	000 030	KuHV DN25 G1½(i)xRp1
17	2	000 598	Spritze mit Wärmeleitpaste
18	15	000 012	DF Ø32xØ44,9x2 EPDM
19	2	000 010	RVP32-NV 10mbar Kvs26
20	1	000 185	IsoBoden 450
21	1	000 065	IsoDeckel 450 ohne
22	1	000 057	IsoStopfen
23	1	000 056	IsoDom rMIX 250
24	2	000 069	Montageschiene 450mm
25	7	000 048	ScheR Ø35(i) M8
26	8	000 070	S M8x8 Li-6K
27	1	000 062	MEin M8x22x11
28	1	000 071	SDrh 6KSW4 71x25
29	2	000 238	OR Ø26,7xØ2,8 NBR
30	1	000 122	OR Ø30xØ2,5 PTFE95
31	7	000 600	IsoRohr Ø18x16
32	1	000 599	KF-GS
33	1	000 751-L	KF-Sync240-Entladung-L
34	1	001 338	PAS DN25 L180

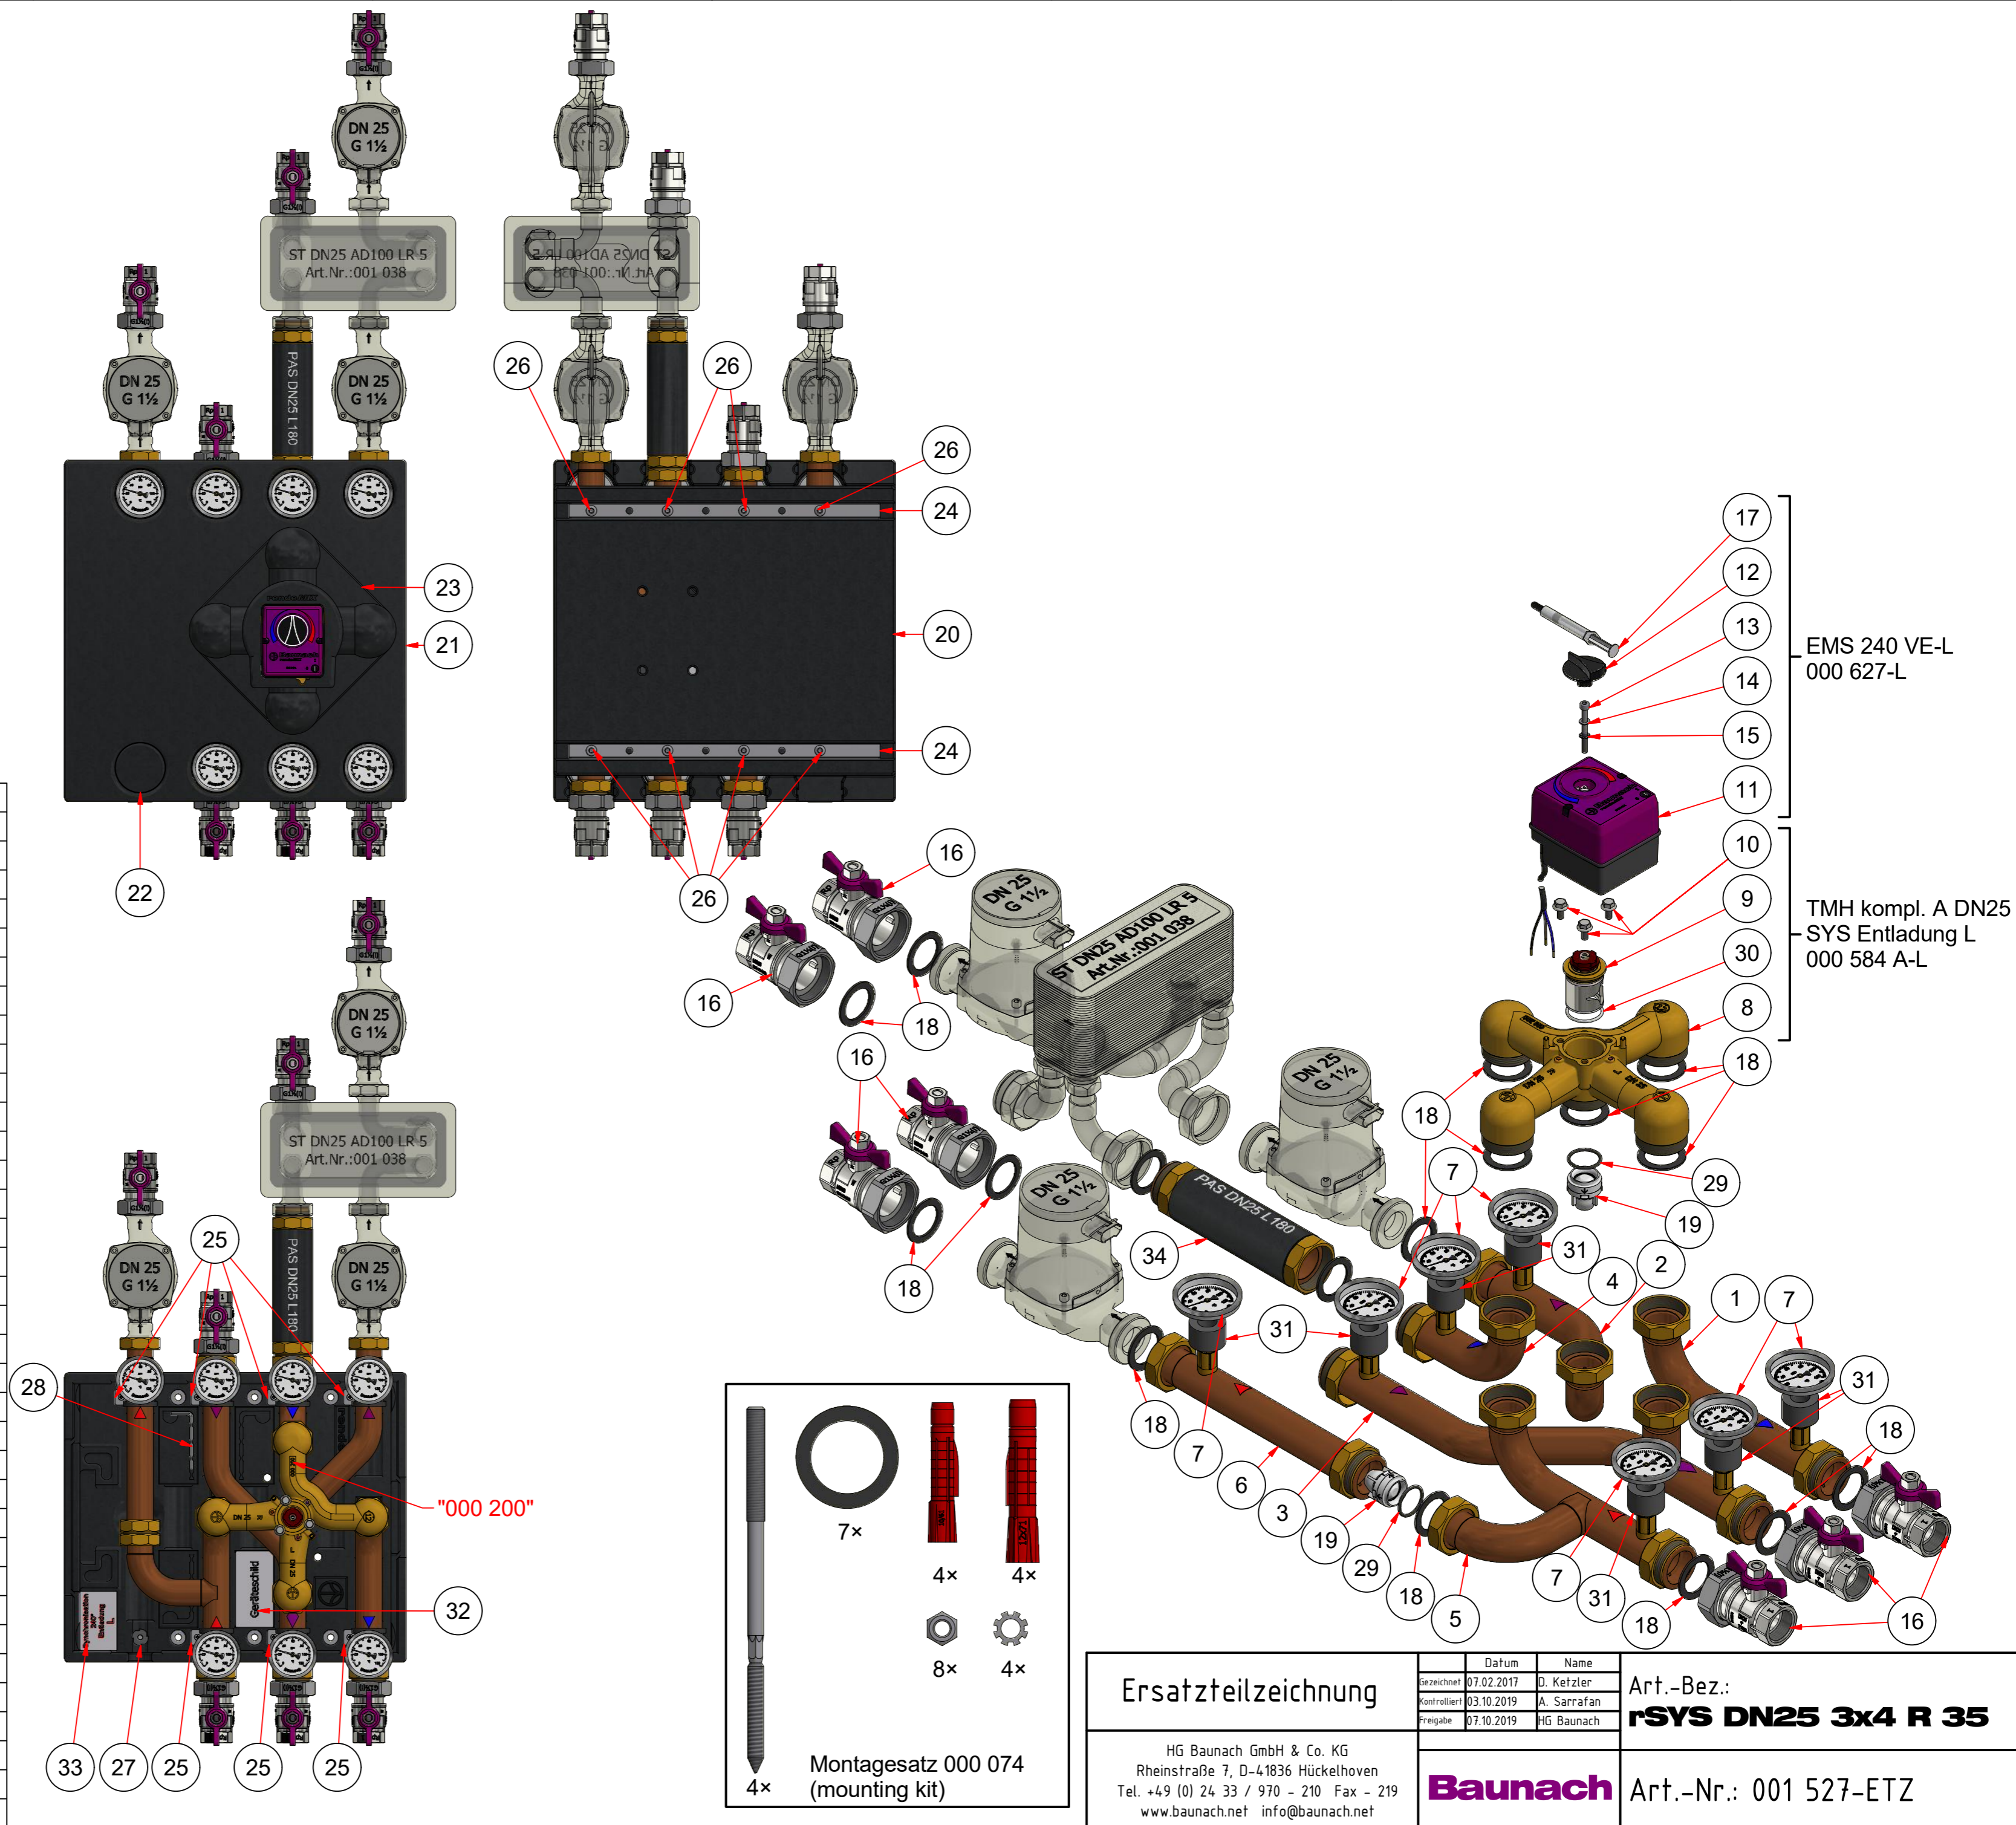

Ersatzteilzeichnung	Datum	Name	Art.-Bez.: <b>rSYS DN25 3x4 R 35</b>
	Gezeichnet	07.02.2017	
HG Baunach GmbH & Co. KG Rheinstraße 7, D-41836 Hückelhoven Tel. +49 (0) 24 33 / 970 - 210 Fax - 219 www.baunach.net info@baunach.net	Kontrolliert	03.10.2019	A. Sarrafan
	Freigabe	07.10.2019	HG Baunach
<b>Baunach</b>		Art.-Nr.: 001 527-ETZ	